

# My Company Name

My Address

To: Lahrmann Engineering Ltd.  
#105 1301 - 8 Street SW.  
Anytown, KS


Dave Paslawski

Project: ESA Phase II  
Maple Creek

# Proctor Report

Project Number: M95-11-814  
Report Number: 2  
Report Date: 28-Nov-95  
Copies To: Client  
Sample Type: 3/4" road crush  
Sampled By: SGI/DB  
Tested By: Site  
Source: SGI/WS  
Sample Date: 28-Nov-95  
Date Received: 24-Nov-95  
Date Tested: 24-Nov-95

Rammer Type: MANUAL  
Preparation: MOIST  
Method: ASTM-D698-C

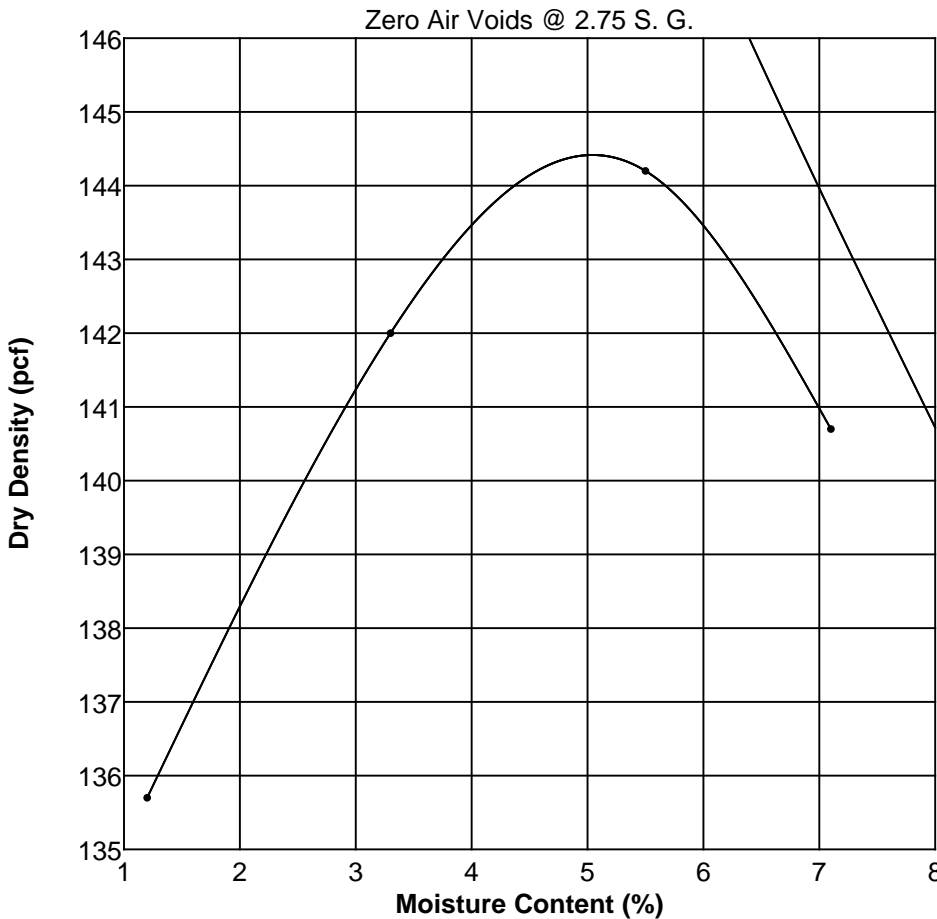

Max. Dry Density (pcf): 144.4  
Optimum Moisture Content (%): 5.0

Moisture Content (%)	Dry Density (pcf)	Wet Density (pcf)
1.2	135.7	137.3
3.3	142.0	146.7
5.5	144.2	152.1
7.1	140.7	150.7

3/4" Road Crush

Per: \_\_\_\_\_